




ALL VALVE BOXES SHALL BE CHECKED FOR CENTER AT THE COMPLETION OF THE PROJECT.
VALVE BOX SHALL BE WITHIN $\frac{1}{4}$ " OF PLUMB CENTER AS IT RELATES TO VALVE NUT.

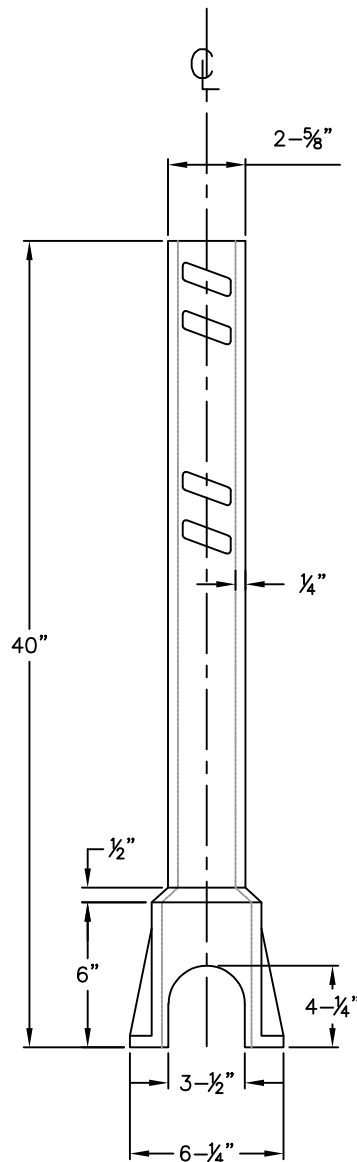


BOTTOM



HEAVY DUTY LID

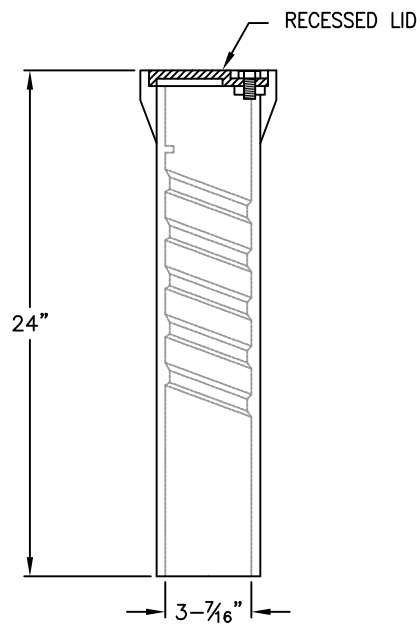

TOP

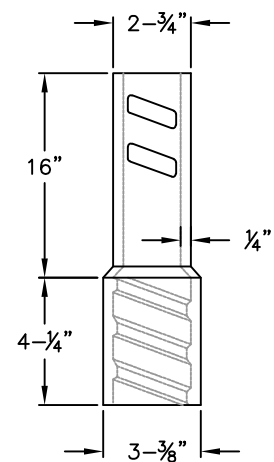

EXTENSION

CURB BOX-BUTTERFLY TYPE, MUELLER NO. H-10350
SIZE 94E, BIBBY-STET CROIX FOUNDRIES INC. MODEL
NO. B-2000 OR EQUAL IF 2" CORP STOP IS USED,
BOX SHALL BE ENLARGED AT BASE SECTION