


1. GREASE TRAP SIZE SHALL BE 15% OF DAILY CAPACITY, OR A MINIMUM OF 1000 GALLS. OR AS DIRECTED BY PORTAGE COUNTY WATER RESOURCES.
2. ALL WALLS, TOP, & BOTTOM OF TANK SHALL BE STEEL REINFORCED, ASTM 615 & ASTM 497, GRADE 40, CONCRETE CLASS "C".
3. ALL 6" PVC PIPING SHALL BE SDR-35 PVC WITH GASKETED JOINTS.
4. JOINTS TO MEET ASTM C-443, OR SHALL BE WATERTIGHT MASTIC JOINT.
5. NO STEPS ARE TO BE INSTALLED.
6. GREASE TRAPS TO BE VENTED IN ACCORDANCE WITH CHAPTER 10 SECTION 1003 OF THE OHIO PLUMBING CODE OR LOCAL CODE.
7. ACCESS OPENINGS SHALL BE CENTERED OVER INLET/OUTLET PIPES TO ALLOW DIRECT ACCESS FROM ABOVE.
8. GREASE TRAP SHALL BE INSPECTED BY THE PORTAGE COUNTY WATER RESOURCES DEPARTMENT PRIOR TO UNLOADING.
9. GREASE TRAP DRAWINGS FROM SHOP MANUFACTURERS ARE NOT PREAPPROVED. A COMPLETE DRAWING SUBMITTAL, INCLUDING SHOP DRAWINGS, IS REQUIRED. DRAWINGS AND SHOP DRAWINGS MUST BE APPROVED BY PORTAGE COUNTY WATER RESOURCES IN WRITING.

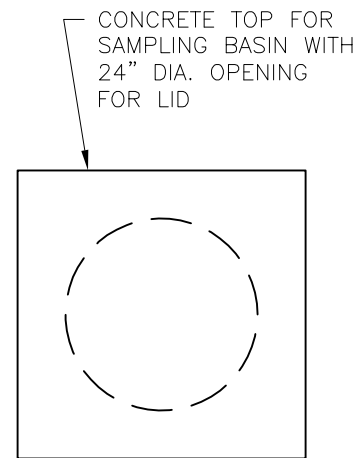

SAMPLING BASIN NOTES:

1. 2' x 2' SQUARE SAMPLING BASIN

1. LINDSEY CONCRETE 1-800-837-7788
2. MACK INDUSTRIES INC. 330-483-3111
3. PORTAGE SEPTIC TANK CO. 330-673-7892
4. MIGCHELBRINK INC. 330-699-2812

