


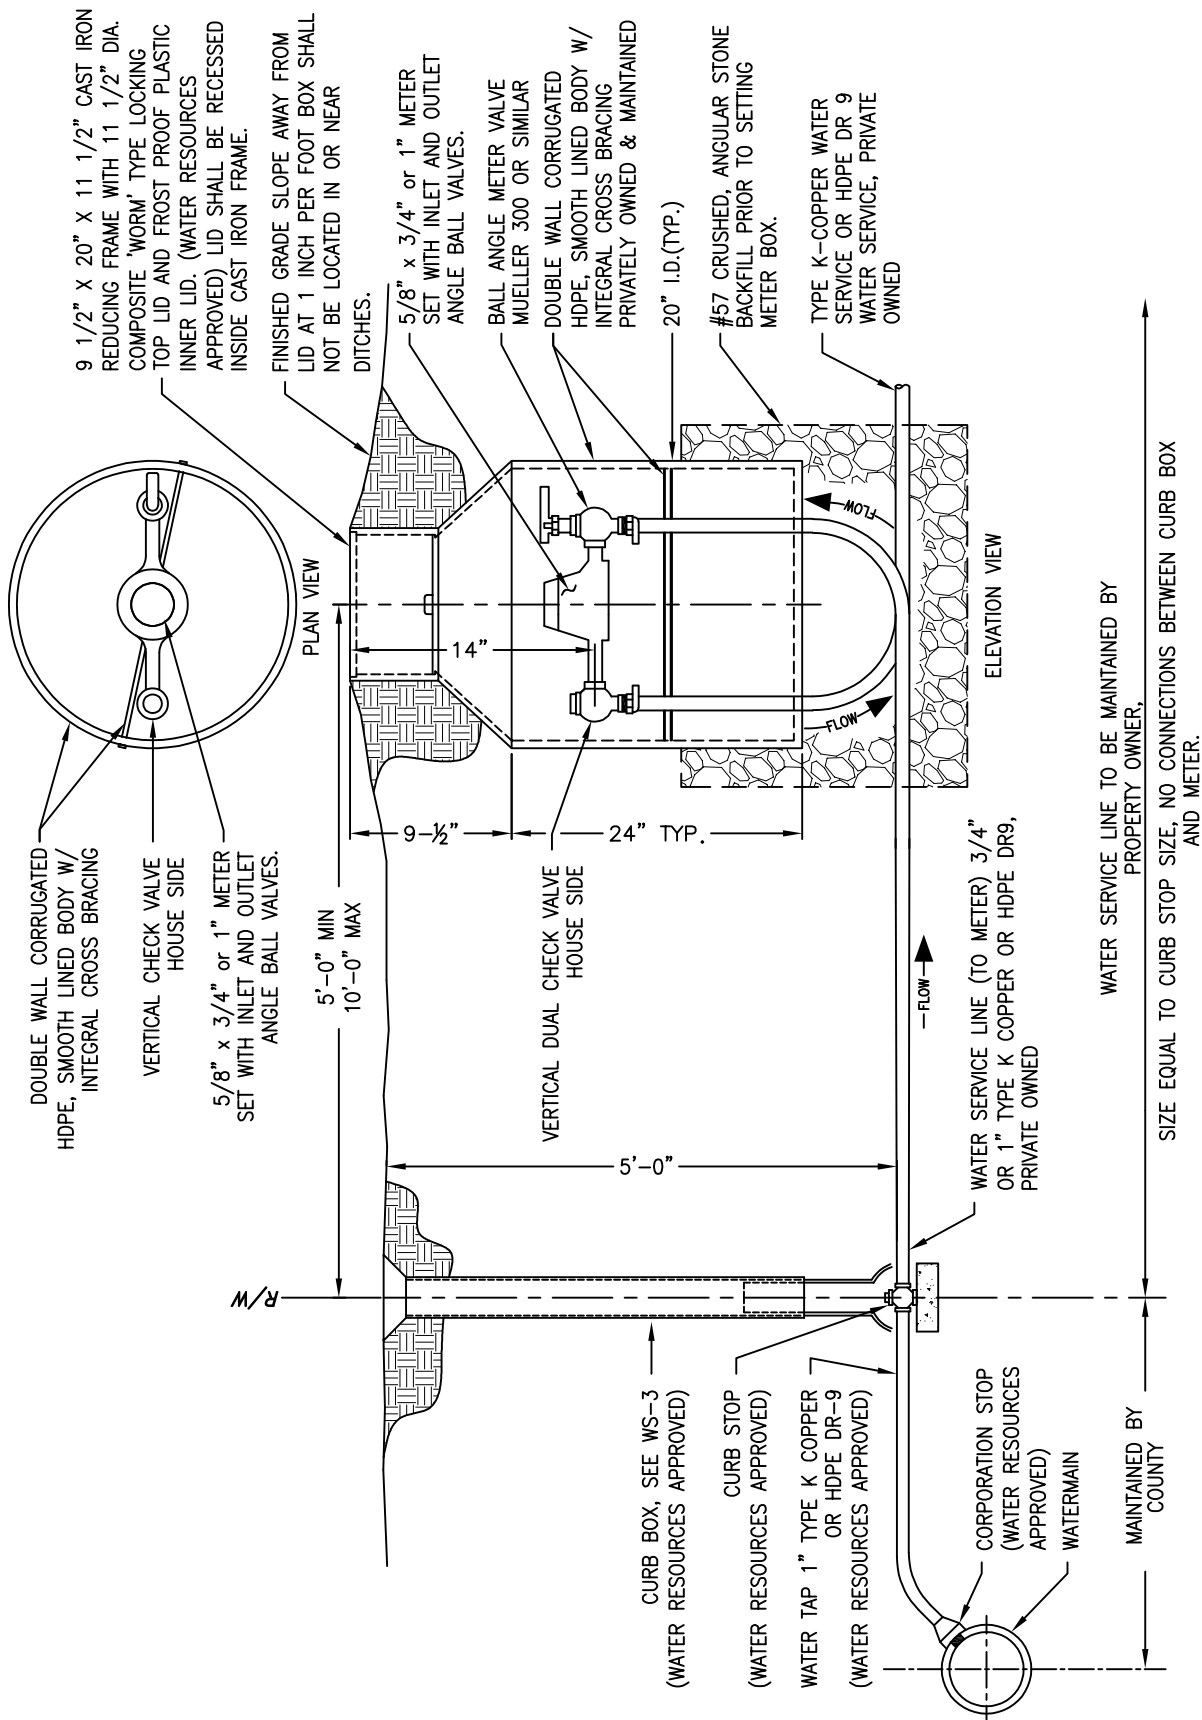

NOTES:

1. FOR REFERENCE IN PLACING NEW CORPORATION STOPS, CURB STOPS AND CURB BOXES SEE WS-3.
2. IF POLY TUBING IS INSTALLED TO EITHER SIDE OF (OR BOTH) THE METER, METER SHALL BE SUPPORTED USING METER YOKE WITH STABILIZING PRONGS ON IRON PIPE STAKES. METER YOKE SHALL BE A FORD H-5020P OR SIMILAR.
3. IF THE METER SIZE IS LESS THAN THE WATER SERVICE LINE SIZE, ANY REDUCERS/INCREASERS SHALL BE PLACED ON THE VERTICAL OUTLET PIPING INSIDE OF THE METER BOX.
4. PIPE SHALL BE SAME OUTSIDE DIAMETER (O.D.) COPPER TUBING SIZE (CTS.) METER BOX SHALL BE USED IN LIEU OF HOUSE METER AS DETERMINED BY PCWR.

PORTAGE COUNTY WATER RESOURCES

TYPICAL METER BOX INSTALLATION

04-01-2023

APPROVED DATE

WS-5